



8485-32-X

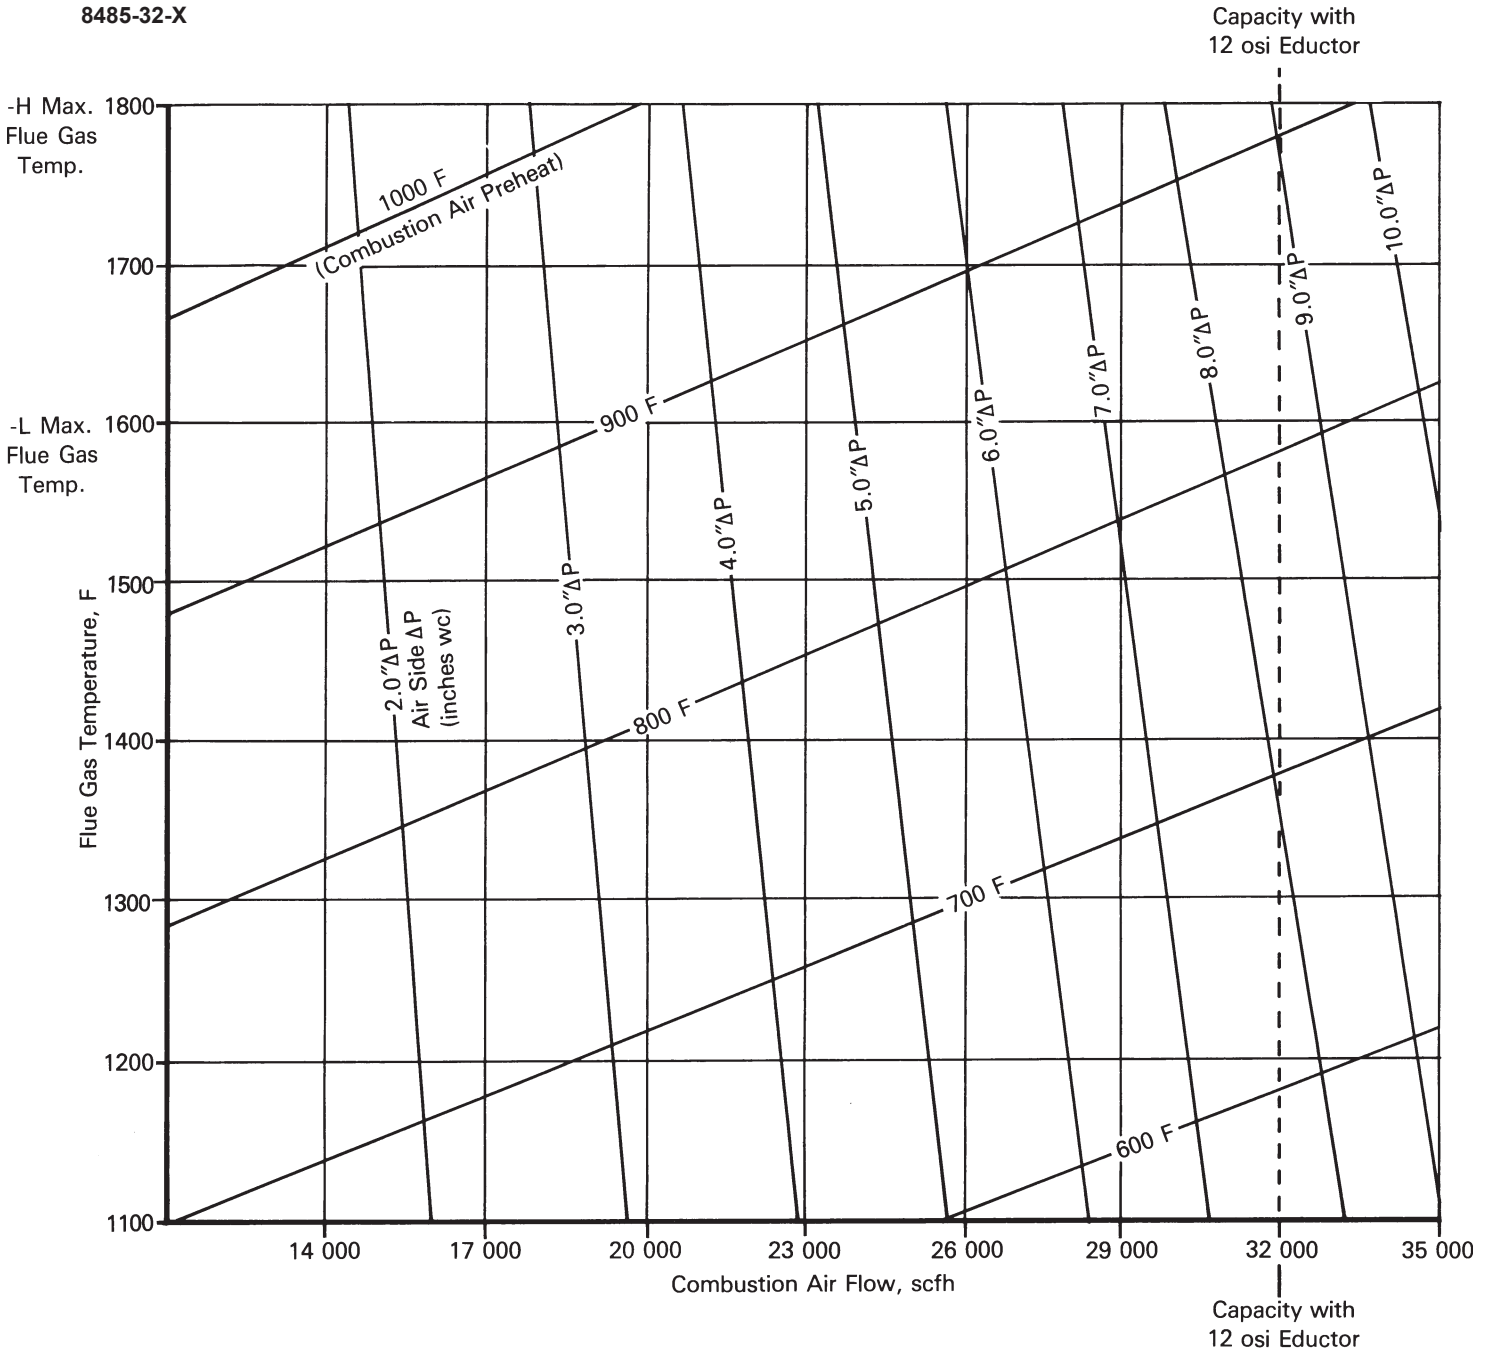

For flue gas temperatures above 1600 F for -L models or 1800 F for -H models, turndowns greater than 3 to 1 will require introduction of flue gas dilution air upstream of the recuperator for its protection. For flue gas temperatures below these levels, dilution air may be required when turndown exceeds 6 to 1, depending on the location of the recuperator.

8485-32-Y

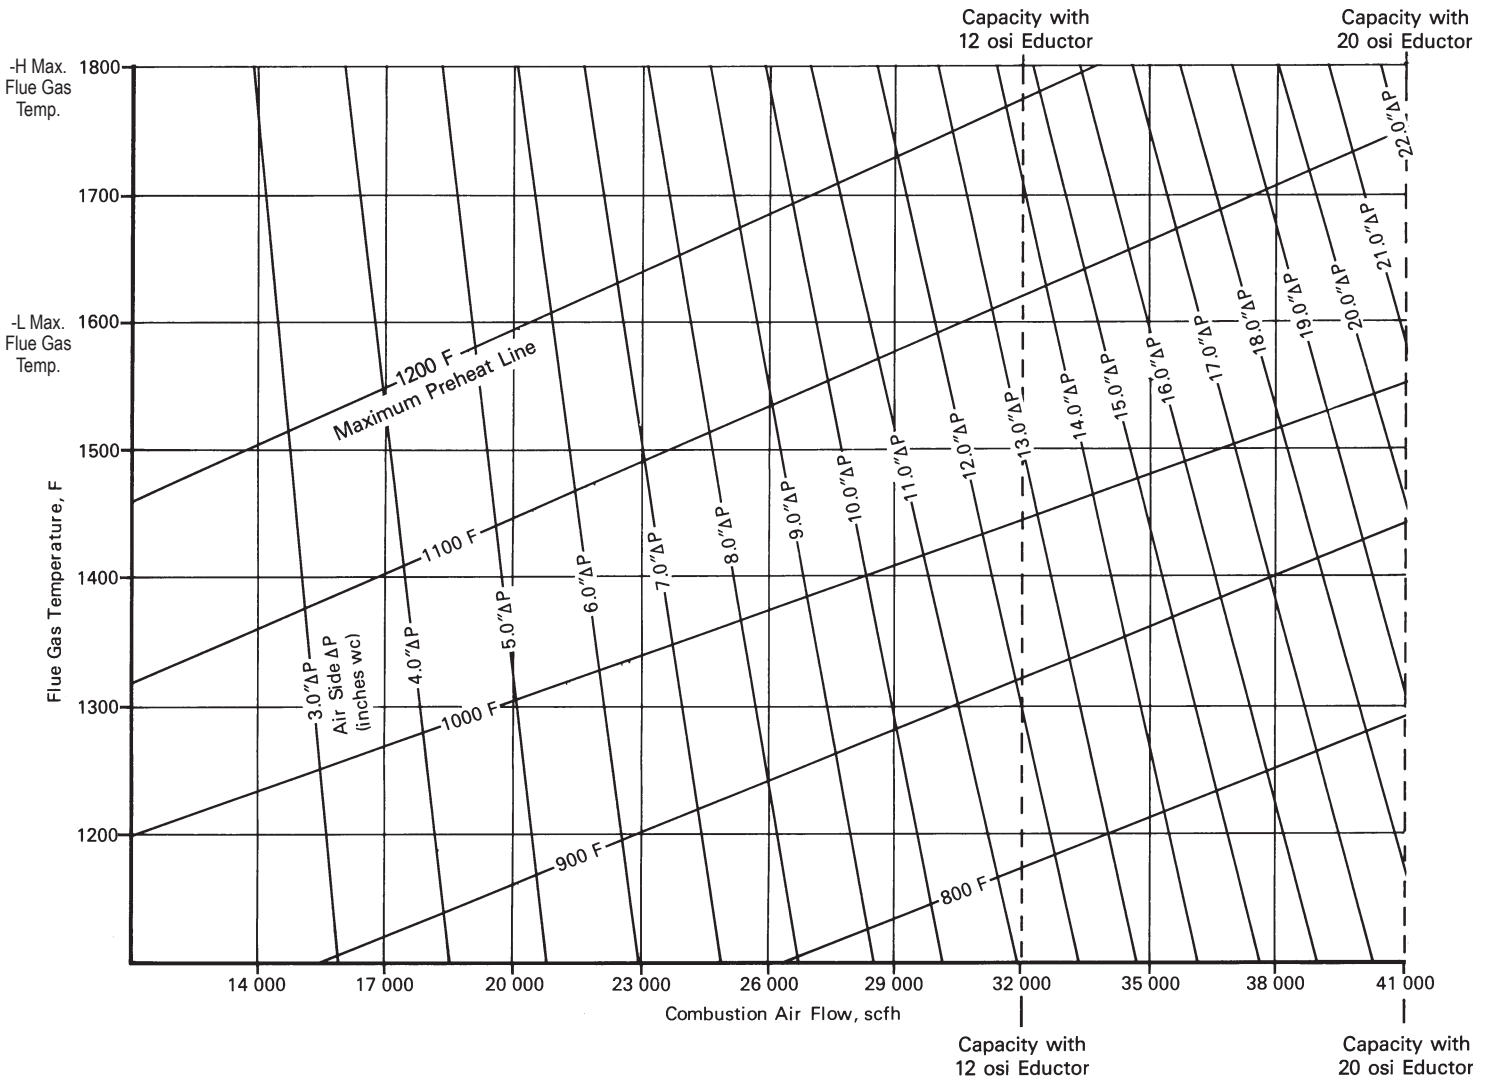

During periods of system turndown, any time preheat exceeds 1200 F, either flue gas dilution air must be introduced upstream of the recuperator for its protection, or flow of combustion air through the recuperator must be increased to limit preheat air temperature to 1200 F. In the latter case, either run the burners at excess air rates, or bleed off some combustion air downstream of the recuperator.

Eductor flow rates can be approximated with the following.

Type Nozzle:

"Special"	12 ori Eductor Blower Pressure	100% of Combustion Air Flow
'R'	16 ori Eductor Blower Pressure	90% of Combustion Air Flow
'S'	20 ori Eductor Blower Pressure	80% of Combustion Air Flow
'T'	24 ori Eductor Blower Pressure	70% of Combustion Air Flow

WARNING: Situations dangerous to personnel and property may exist with the operation and maintenance of any combustion equipment. The presence of fuels, oxidants, hot and cold combustion products, hot surfaces, electrical power in control and ignition circuits, etc., are inherent with any combustion application. Parts of this product may exceed 160F in operation and present a contact hazard. Fives North American urges compliance with National Safety Standards and insurance Underwriters recommendations, and care in operation.

Fives North American Combustion, Inc., 4455 East 71st Street, Cleveland, OH 44105 USA, Phone 216.271.6000
Fax 216.641.7852 email: fna.sales@fivesgroup.com • www.fivesgroup.com/fivesna